


**FORCES**

* R1	* R2
1382 LB [621 kg]	882 LB [400 kg]
1304 LB [591 kg]	1194 LB [541 kg]
RAIL ASSY WEIGHT: 0.81 lbs / ft	2.45 lbs / ft
PIT FORCE: R3	
PIT FLOOR TO SUPPORT LOAD (INCLUDES IMPACT)	
2909 kg	
6400 lbs	



**CHARACTERISTICS**

**GENERAL**

APPLIED CODE: \_\_\_\_\_ CONCORD

CAPACITY: \_\_\_\_\_ (750, 1000 LBS)

NOMINAL SPEED: \_\_\_\_\_ 40 FPM

TRAVEL: \_\_\_\_\_ (MIN. 6')

PIT DEPTH: \_\_\_\_\_ (MIN. 6')

**CAR DETAILS**

CAB PANEL SELECTION: \_\_\_\_\_ (SEE CHART)

CEILING SELECTION: \_\_\_\_\_ (WITH/MATCH)

CAB FLOORING: \_\_\_\_\_ (PLY, FINISH)

FINISHED FLOOR THICKNESS: \_\_\_\_\_ (1/8 TO 3/4")

CAB HEIGHT: \_\_\_\_\_ (80, 96")

CAB OPERATION: \_\_\_\_\_ (AUTO)

GATE TYPE: \_\_\_\_\_ (V.FOLD, C.FOLD, P.FOLD CLR, P.FOLD BRZ, BLK SCZR)

**LOCKS/CALL STATIONS/TRAVEL/DOORS (BY OTHERS)**

TRAVEL	LANDING 1	LANDING 2	LANDING 3	LANDING 4
ENTRANCE SIDE	SIDE C			
DOOR SWING				
LOCK TYPE				
AUTO DOOR OP.				

**STANDARD OPTIONS PROVIDED:**

BUTTON MARKING: NUMERIC (1 to 4)

HALL CALL KEYS: NO

HALL CALL FINISH: MATCH CAR STATION

HALL CALL SHAPE: RECTANGULAR

PREWIRE PACKAGE: NO

CONTROLLER LOCATION: EXTERNAL

**DRIVE UNIT**

DRIVE ASSEMBLY MFR. \_\_\_\_\_ CONCORD

MOTOR \_\_\_\_\_ 2.0 HP/1660 RPM V/Broke

GEAR MODEL \_\_\_\_\_ 42:1/1 Ratio Gear Box

MOTOR CONTROLLER \_\_\_\_\_ Pre-programmed V/F Drive

**SUSPENSION**


TYPE \_\_\_\_\_ DUAL #60 ROLLER CHAIN

CONSTRUCTION: \_\_\_\_\_ ANSI B29.1

NOMINAL STRENGTH: \_\_\_\_\_ 9020 LBS PER CHAIN

ELECTRICAL

POWER SUPPLY: \_\_\_\_\_ 60 Hz/1 Phase/230 volt

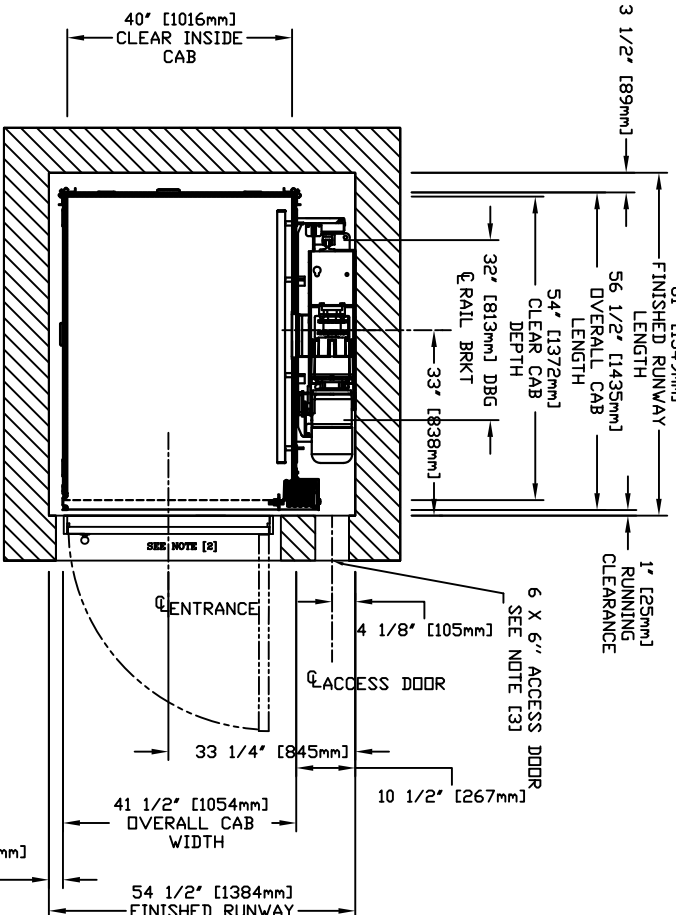

**\*HOISTWAY CONSTRUCTION SITE CLEARANCE**

- HOISTWAY CONSTRUCTION AND PIT BY OTHERS. DUE TO LIMITED SPACE WITHIN THE HOISTWAY IT IS ESSENTIAL THAT THE PIT IS LEVEL AND VALTS ARE SQUARE AND PLUMB THROUGHOUT THE HOISTWAY. THE HOISTWAY FRAMING MUST BE WITHIN 1/2" OF PLUMB AND SQUARE FROM TOP TO BOTTOM FOR PROPER OPERATION OF THE ELEVATOR THROUGHOUT THE HOISTWAY.
- CLEARANCES FROM DOOR SILL TO HOISTWAY DOOR TO BE 76 mm [3"] MINIMUM AND ELEVATOR CAR DOOR TO HOISTWAY DOOR TO BE 127 mm [5"] MINIMUM TO COMPLY WITH CSA B44 (ASME/ANSI A17.1) CONSULT YOUR LOCAL AUTHORITY FOR CODES WHICH MAY TAKE PRECEDENCE.
- HOISTWAY MUST HAVE A MINIMUM 152 mm x 152 mm (6" x 6") LOCKABLE ACCESS HATCH PROVIDED BY SAVARIA CONCORD LOCATED AT THE TOP OF THE HOISTWAY. LOCATION MUST BE IN AN AREA WHICH WILL PROVIDE ACCESS TO THE ELEVATOR DRIVE ASSEMBLY BY THE MANUAL LOWERING HANDLE. MANUAL LOWERING HANDLE WILL ENABLE USER TO OVERPOWER BRAKE AND LOWER CAR WITHOUT BOBBLY ENTRY TO THE SHAFTHWAY.
- THE PIT FLOOR SHALL BE CONSTRUCTED TO WITHSTAND AN IMPACT LOAD OF 2903 KG [6400 LBS]. REF. CSA B44 SECTION 2.11 (ASME/ANSI A17.1 SECTION 10.6)
- HOISTWAY TO BE FREE OF ALL PIPES, WIRING AND OBSTRUCTIONS NOT RELATED TO THE OPERATION OF THE ELEVATOR.
- FOR COMPLYING WITH LOCAL CODES.
- HOISTWAY CONSTRUCTION REQUIREMENTS MAY VARY FROM REGION TO REGION. THE DIMENSIONS GIVEN ARE MANUFACTURERS RECOMMENDED CLEARANCES. THEY REFLECT RUNNING AND ACCESS CLEARANCES. CONSULT YOUR LOCAL AUTHORITY TO ASSURE COMPLIANCE WITH PROVINCE AND LOCAL CODES.

**DIMENSIONS WARNING**

CONTRACTOR/CUSTOMER TO VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO OUR OFFICE IMMEDIATELY.

**\*STRUCTURAL**

- A LOAD BEARING WALL IS REQUIRED TO SUSTAIN RAIL REACTIONS AS SPECIFIED IN KEY TO RAIL REACTIONS ON DRAWING. BUILDING CONTRACTOR TO CONTACT STRUCTURAL ENGINEER TO DETERMINE IF SUPPORTING WALL WILL SUSTAIN RAIL REACTIONS. FOR COMPLYING WITH LOCAL CODES.
- SUITABLE LINTELS MUST BE PROVIDED BY DWNER/AGENT.
- DOOR FRAMES ARE NOT DESIGNED TO SUPPORT OVERHEAD WALL LOADS.
- ALL FULL HEIGHT DOORS MUST BE ALIGNED WITH THE DOOR CENTERLINE SHOWN ON PLAN DETAIL. RECOMMEND INSTALLING A SOLID CORE 2032 mm [6'-8"] HIGH DOOR WITH A MINIMUM CLEAR OPENING OF 813 mm [2'-8"] WIDE.
- DOOR HANDLE AND LATCH SET REQUIRED FOR ALL FULL SIZE DOORS.
- SEE INSTALLATION MANUAL FOR DETAILS ON THE INTERLOCKS. INTERLOCKS ARE REQUIRED FOR ALL FULL SIZE DOORS.

**\*ELECTRICAL**

- THE ELEVATOR CONTROLLER IS PROVIDED BY SAVARIA CONCORD AND IS EITHER 1677 mm [5'-6"] DEEP. THE CONTROLLER IS PROVIDED BY THE HOISTWAY BETWEEN THE 7" RAILS A. ATTACHED TO THE RAIL WALL INSIDE THE HOISTWAY BETWEEN THE 7" RAILS WITH ACCESS EITHER UNDER THE CAB OR THROUGH THE CAB OF THE ELEVATOR OR B. IN A REMOTE LOCATION EXTERNAL TO HOISTWAY, THAT NEEDS PROPER STRUCTURAL WALL TO SUPPORT THE CONTROLLER ON ALL 4 CORNERS HOLES POSITION ARE = 597 mm [23.5"] WIDE BY 546 mm [21.5"] HIGH.
- ARRANGE FOR A POWER SUPPLY WITHIN SIGHT OR NEXT TO THE ELEVATOR CONTROLLER PRIOR TO DELIVERY OF THE UNIT(BOTH 115 VOLT AND 208/240 VOLT). THE 208/240 VOLT CIRCUIT SHALL ORIGINATE FROM A LOCKABLE 2 PILE FUSED DISCONNECT (20 AMP RK 5 RATED FUSED CIRCUIT NEAR THE RESIDENCES INCOMING ELECTRICAL PANEL THE ELECTRICAL CIRCUIT PROVIDED FOR THE CONTROLLER SHALL BE 208/240 VOLT, SINGLE PHASE, DEICATED CIRCUIT WITH NEUTRAL AND GROUND. FUSING MUST BE SELECTIVELY COORDINATED. FUSE 208/240 VOLT FOR 20 AMP SERVICE. FUSE 115 VOLT FOR 15 AMP SERVICE FOR CAR LIGHT. A LOCKABLE AUXILIARY 240 VOLT AND 115 VOLT DISCONNECT IS REQUIRED INSIDE THE HOISTWAY OR IN SIGHT OF THE CONTROLLER. ALL ELECTRICAL TO DISCONNECTS SHALL BE PROVIDED AND INSTALLED BY OTHERS (MUST COMPLY WITH APPLICABLE CODES).
- FIELD ELECTRICAL WIRING AND CONNECTIONS TO HALL-CALLS, PIT SWITCH AND INTERLOCKS ARE PROVIDED.
- THE ILLUMINATION SHALL BE NOT LESS THAN 200 LX [9 FC] AT THE FLOOR LEVEL IN ALL MACHINE ROOMS AND MACHINERY SPACES. THE SWITCH FOR THE LIGHT MUST BE WITHIN 457 mm [18"] OF THE HOISTWAY ACCESS. THE LIGHT MUST BE GUARDED, LIGHT, PREVENT ACCIDENTAL BREAKAGE OR CONTACT WITH THE HOT BULB. THE SWITCH, LIGHT, AND GUARD ARE PROVIDED AND INSTALLED BY OTHERS. (MUST COMPLY WITH APPLICABLE CODES).
- IF A TELEPHONE CIRCUIT IS REQUIRED (OPTION FOR ELEVATOR) JACK IS PROVIDED AND INSTALLED BY OTHERS. THIS CIRCUIT SHALL BE BROUGHT TO A LOCATION NEXT TO THE CONTROLLER AND BE AVAILABLE TO CONNECT AND TEST UPON ELEVATOR INSTALLATION.
- WHEN CONTROLLER EXTERNAL
- LOCATION / ACCESS - "CONTROLLER ROOM" LOCATED AT THE LOWEST LEVEL ADJACENT TO HOISTWAY, UNLESS SHOWN OTHERWISE ON THE LAYOUT DRAWINGS. FIELD ADJUSTMENT BY INSTALLER MAY BE NECESSARY TO MEET JOB SITE CONDITIONS OR REGULATIONS. ACCESS TO CONTROLLER ROOM TO BE THROUGH A SELF CLOSING LOCKABLE DOOR WHERE CODE CONSIDER IT AS A MACHINE ROOM
- WHEN APPLICABLE SLEEVES FOR ELECTRIC LINES -
- FROM CONTROLLER ROOM TO RUNWAY AS REQUIRED.
- POSITION PER INSTALLERS INSTRUCTIONS.

**\*CODE**

- ALTHOUGH THE ELEVATOR IS DESIGNED TO MEET CSA B44 (ANSI A17.1), LOCAL CODES MAY VARY. DEALER IS RESPONSIBLE FOR COMPLYING WITH LOCAL CODES.
- NOTE A
- ALL COMPONENTS WEIGHTS CAN BE FOUND IN THE PLANNING GUIDE
- NOTE B

ALL INFORMATION IS SUBJECT TO CHANGE.

PLEASE REFERENCE OUR ON-LINE DRAWINGS AT

WWW.SAVARIACONCORD.COM FOR THE MOST RECENT UPDATES

**RESIDENTIAL ELEVATOR**

ECLIPSE MODEL 40X54 TYPE 1R

CUSTOMER:	DATE:
PROJECT:	REVISION DATE:
LOCATION:	COMPLETED BY:

SAVARIA CONCORD  
Your Accessibility Partners

SHEET # 1/1